

**CENTRAL MAINE POWER COMPANY  
RESPONSE TO COMPETITIVE ENERGY SERVICES' DATA REQUEST NO. 1  
DOCKET No. 2008-255**

**CONFIDENTIAL  
MATERIAL  
ATTACHED**

**October 3, 2008**

**CES-01-07**

**Q.** Please describe in detail, showing the actual calculations and excel spreadsheets, the adjustments that were made to the actual 2006 load levels for the 6 small industrial facilities shown in Table 2 on Page 7 of 9.

**A.** The adjustment was to set the load of the six small industrial facilities to the levels shown in Table 2 on Page 7 of 9. The explanation is provided in Exhibit B-2, subsection F, on page 6 of 9. A diagram for each small industrial facility showing the assumed bus load is shown in Attachment 1.

**The attachment to this reponse is confidential and is being provided under the terms and conditions of First Revised Protective Order No. 2, Critical Energy Infrastructure Information, dated August 27, 2008.**

**Response Prepared and Submitted By:**


Rick Conant  
Manager, Power System Studies  
RLC Engineering

**Attachment:**

1. Diagram


# CONFIDENTIAL

CES-01-07  
Attachment 1, p. 1 of 6  
Docket No. 2008-255

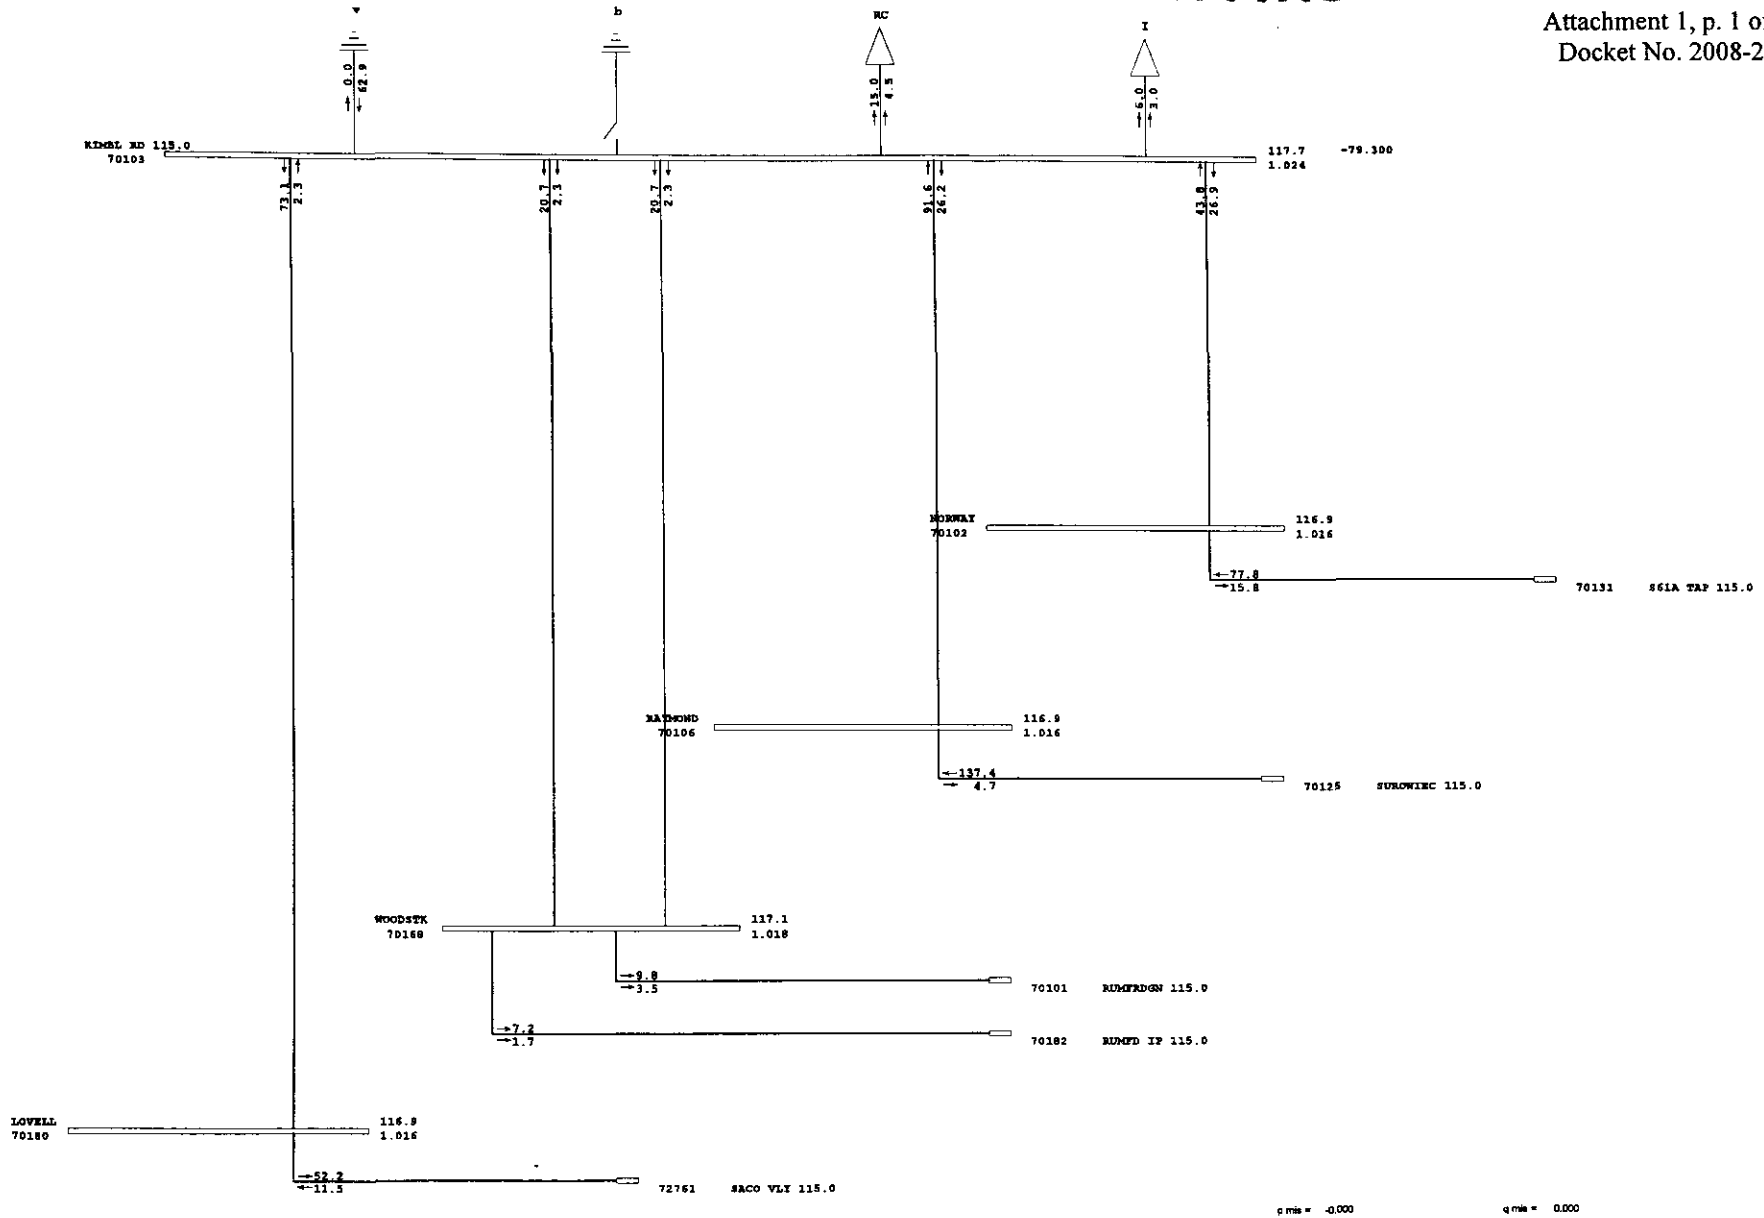


# CONFIDENTIAL

CES-01-07  
Attachment 1, p. 2 of 6  
Docket No. 2008-255

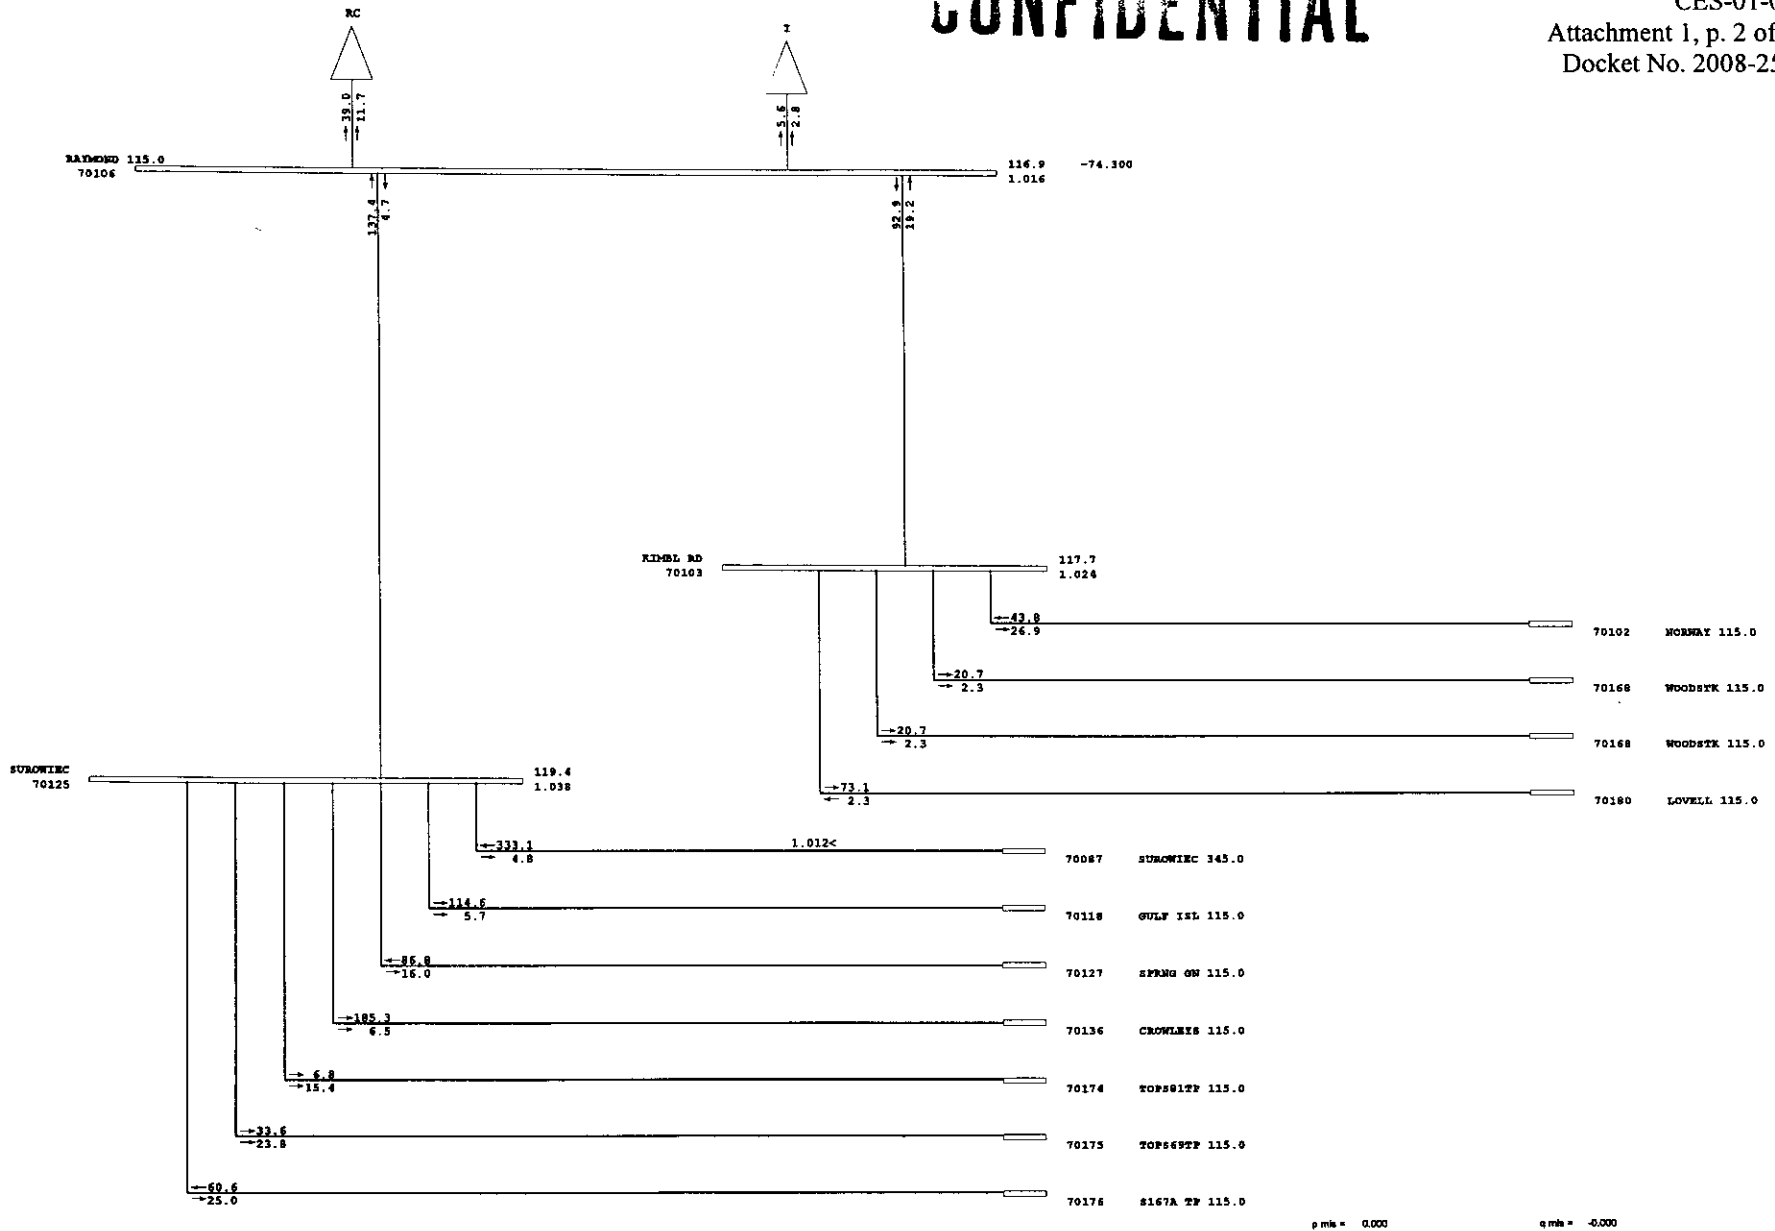


# CONFIDENTIAL

CES-01-07  
Attachment 1, p. 3 of 6  
Docket No. 2008-255

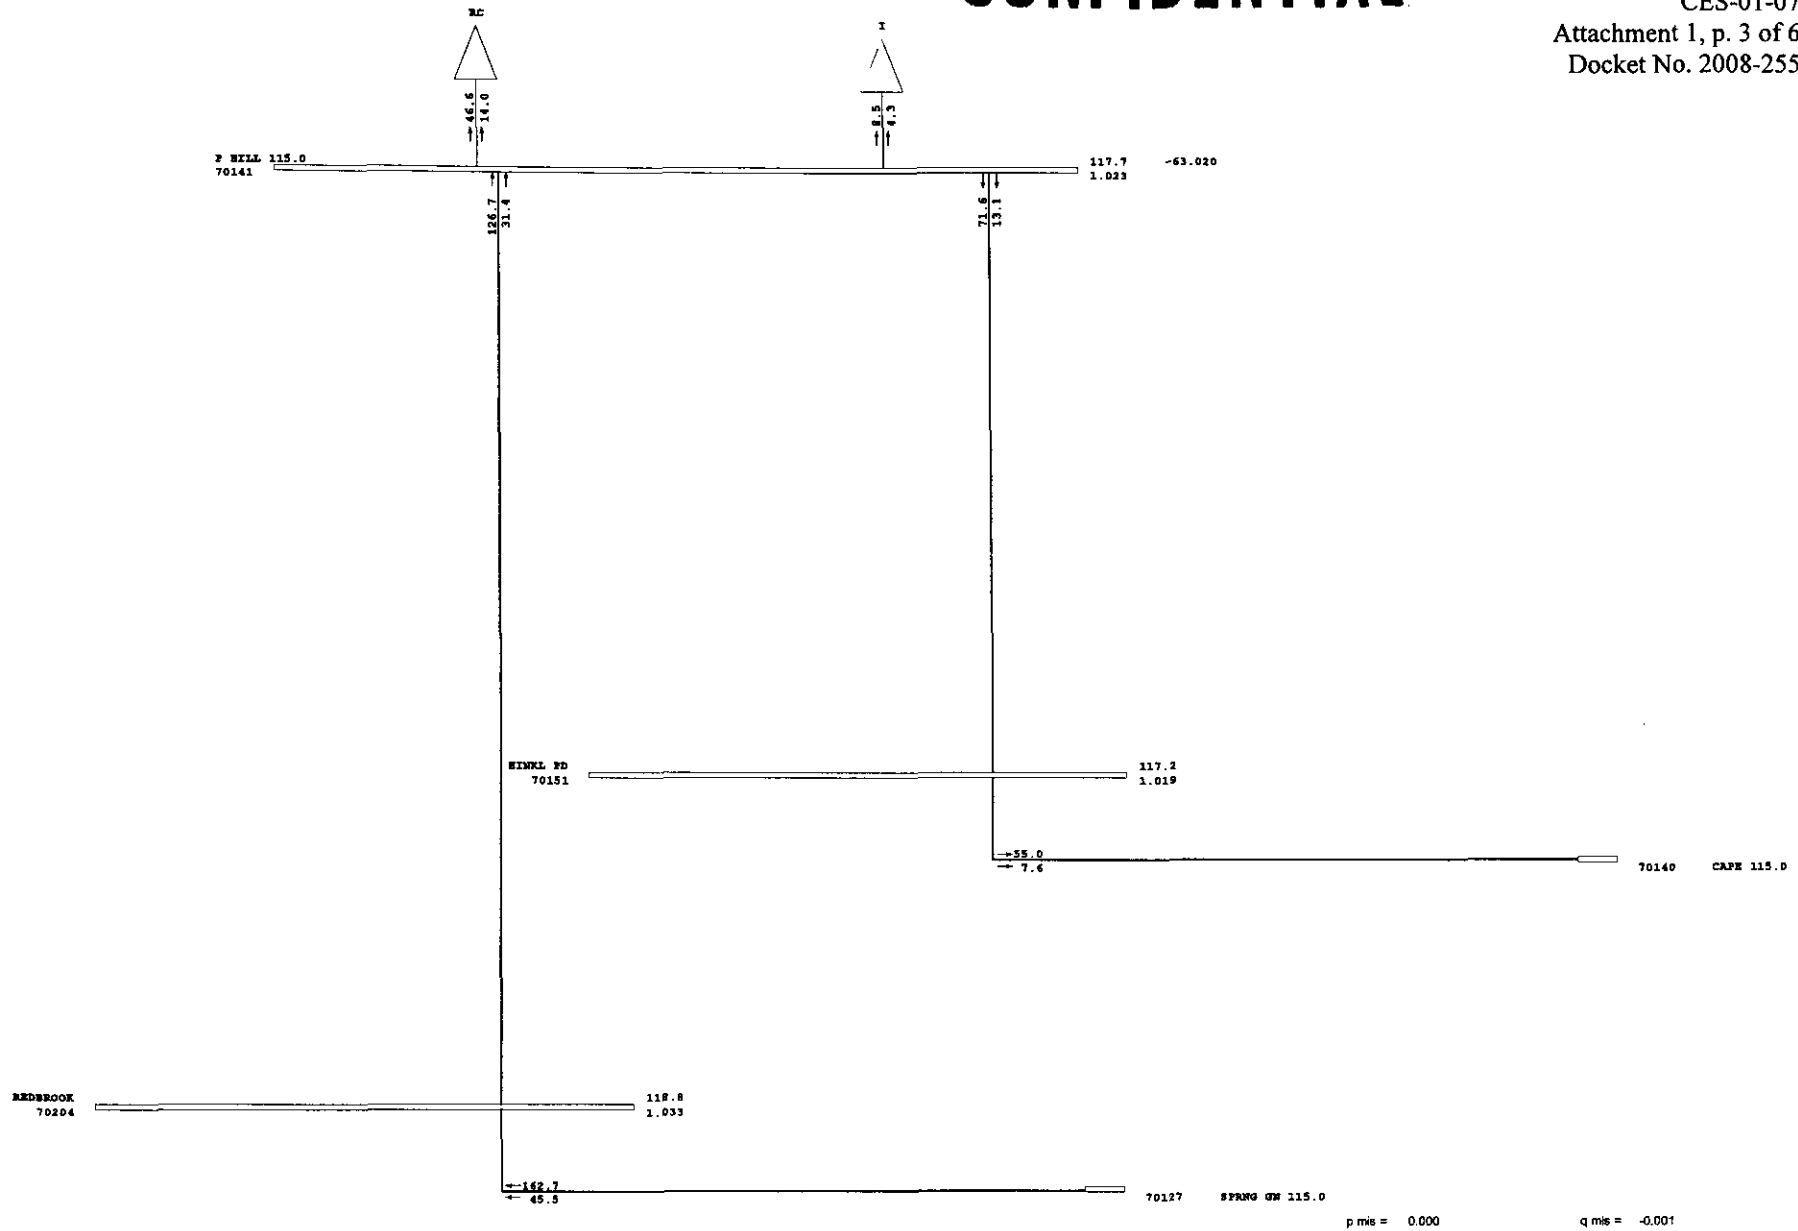


# CONFIDENTIAL

CES-01-07  
Attachment 1, p. 4 of 6  
Docket No. 2008-255

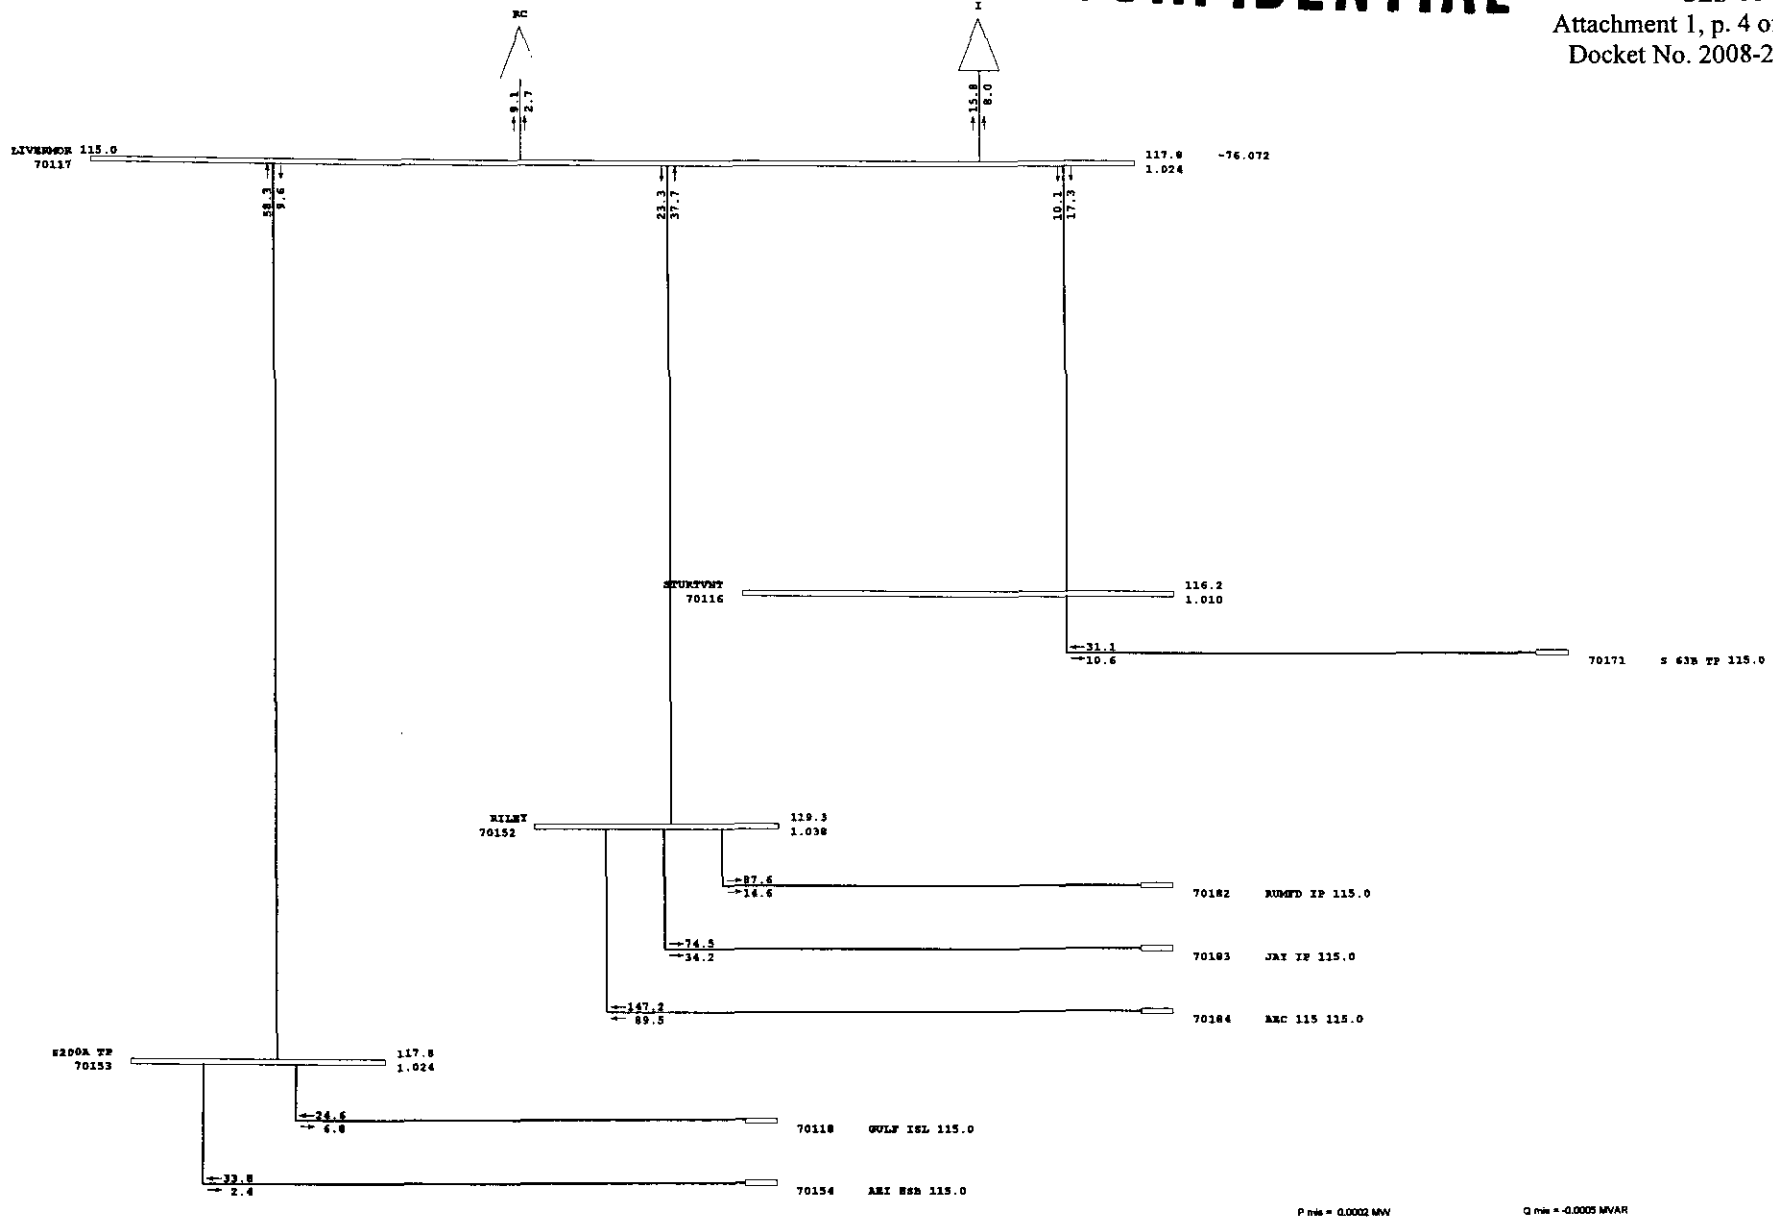

# CONFIDENTIAL

CES-01-07  
Attachment 1, p. 5 of 6  
Docket No. 2008-255

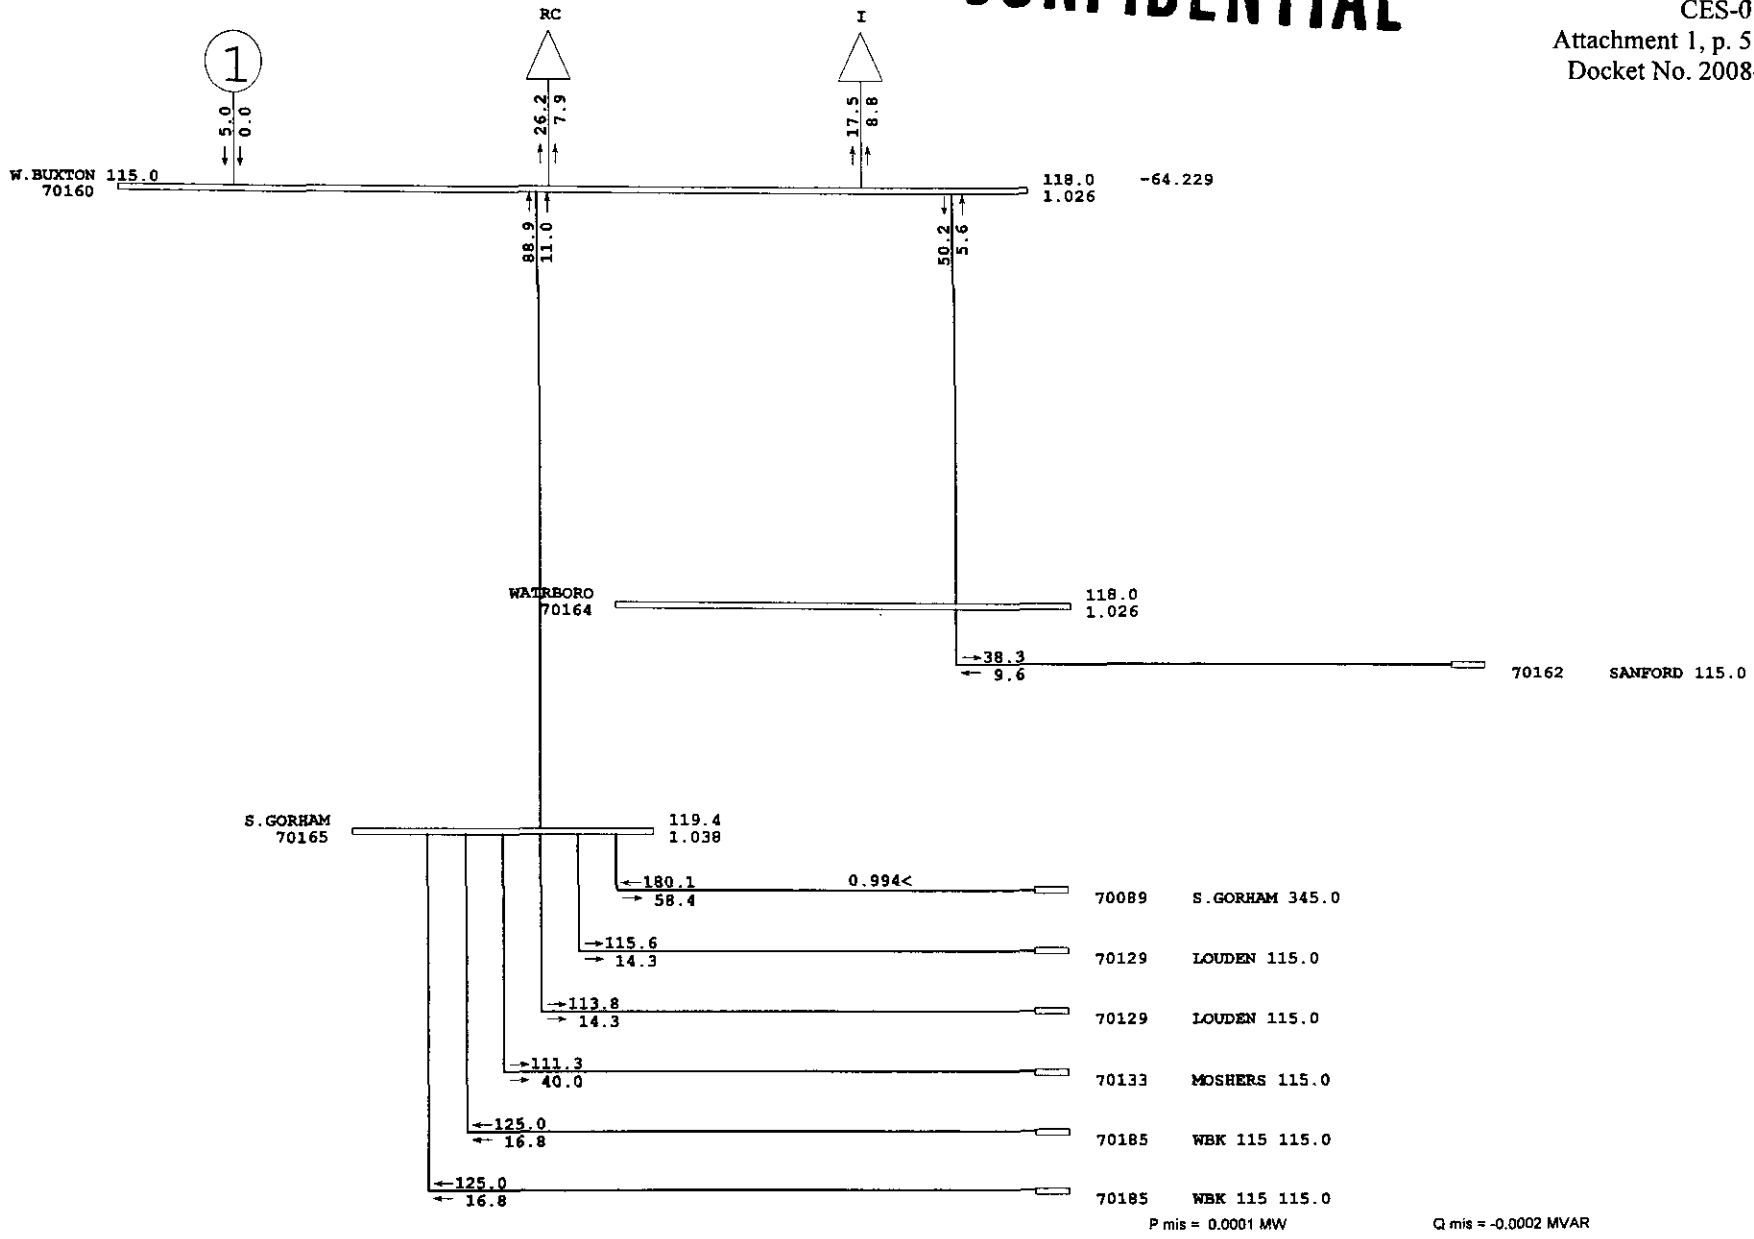

# CONFIDENTIAL

CES-01-07  
Attachment 1, p. 6 of 6  
Docket No. 2008-255

